




**SIDE-HINGED METAL-EDGE STEEL DOOR UNIT
6'-8" GLAZED DOUBLE DOOR WITH / WITHOUT SIDELITES**

GENERAL NOTES

- EVALUATED FOR USE IN LOCATIONS ADHERING TO THE FLORIDA BUILDING CODE AND WHERE PRESSURE REQUIREMENTS AS DETERMINED BY ASCE 7, MINIMUM DESIGN LOADS FOR BUILDINGS AND OTHER STRUCTURES, DOES NOT EXCEED THE DESIGN PRESSURES LISTED.
- HURRICANE PROTECTIVE SYSTEM (SHUTTERS) IS REQUIRED.
- POLYURETHANE CORE FLAME SPREAD INDEX OF 50 AND SMOKE DEVELOPED INDEX OF 60 PER ASTM E84.
- PLASTICS TESTING OF LITE FRAME MATERIAL:

TEST DESCRIPTION	DESIGNATION	RESULT
SELF IGNITION TEMP	ASTM D1929	680 °F > 650 °F
RATE OF BURNING	ASTM D635	1.10 IN/MIN
SMOKE DENSITY	ASTM D2843	69.6%
TENSILE STRENGTH*	ASTM D638	-7.48% DIFF


* COMPARATIVE TENSILE STRENGTH AFTER WEATHERING
4500 HOURS XENON ARC METHOD 1

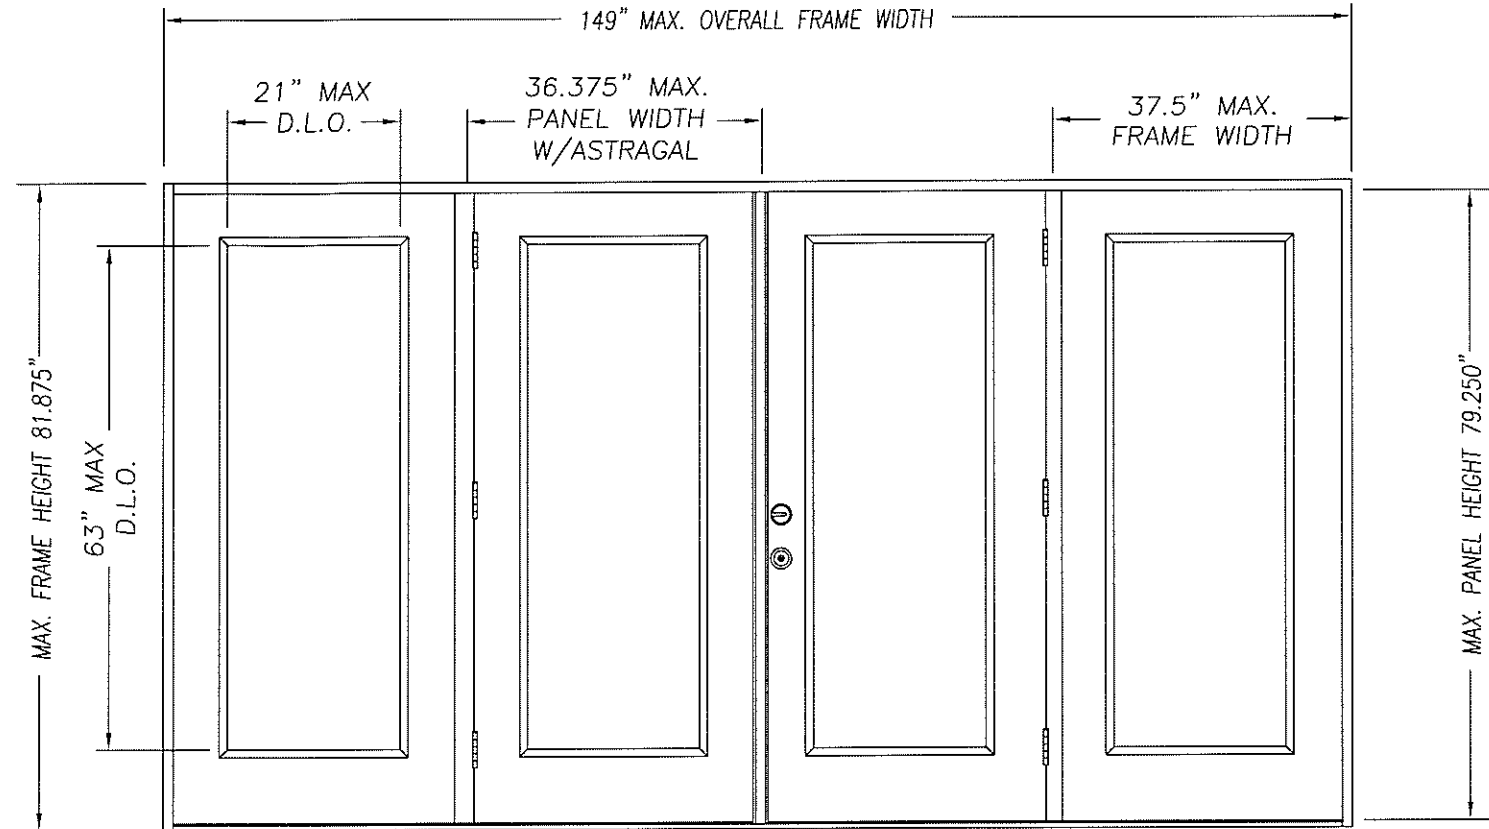


DOUBLE DOOR UNIT W/SIDELITES

Addendum to NAMI


Certification No.: NI006115-R2
Reviewed By: [Signature]
Date Reviewed: 12/18/08

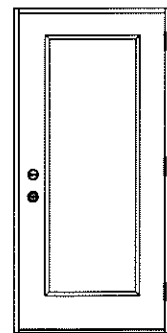


SINGLE DOOR UNIT

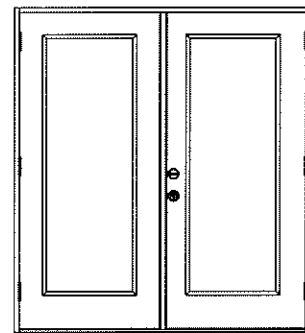


DOUBLE DOOR UNIT

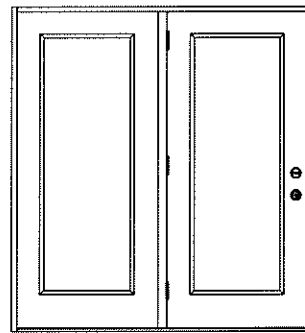


SINGLE DOOR UNIT
WITH SIDELITE

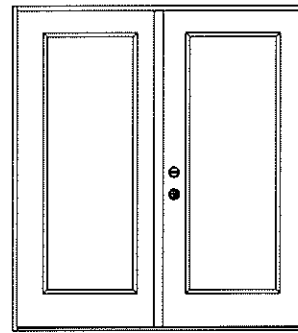

SINGLE DOOR UNIT
WITH SIDELITE

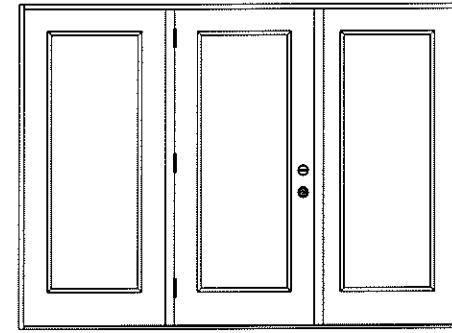

SINGLE DOOR UNIT W/SIDELITES

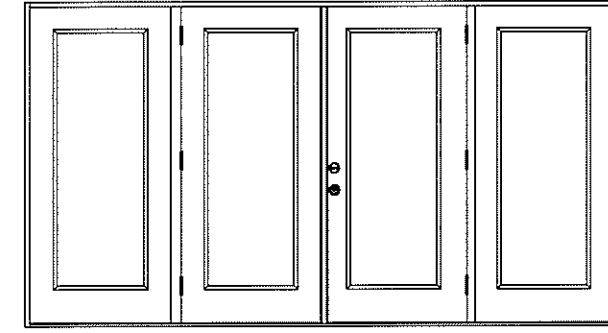

DOUBLE DOOR UNIT W/SIDELITES

TABLE OF CONTENTS	
SHEET #	DESCRIPTION
1	TYPICAL ELEVATIONS & GENERAL NOTES
2	ANCHORING LOCATIONS & DETAILS
3	ANCHORING LOCATIONS & DETAILS





CONFIG	MAX WIDTH	DESIGN PRESSURE RATING		WHERE WATER INFILTRATION PERFORMANCE IS REQUIRED TO BE 15% OF DESIGN PRESSURE	
		INSWING	OUTSWING	INSWING	OUTSWING
X	37.5"	+50.5 / -50.5	+50.5 / -50.5	+19.0 / -19.0	+50.5 / -50.5
XX	74"	+50.5 / -50.5	+50.5 / -50.5	+19.0 / -19.0	+50.5 / -50.5
OX or XO	75"	+50.5 / -50.5	+50.5 / -50.5	+19.0 / -19.0	+50.5 / -50.5
OXO	112.5"	+50.5 / -50.5	+50.5 / -50.5	+19.0 / -19.0	+50.5 / -50.5
OXXO	149"	+50.5 / -50.5	+50.5 / -50.5	+19.0 / -19.0	+50.5 / -50.5

MASONITE INTERNATIONAL CORP.
7300 REAMES RD.
CHARLOTTE, NC 28216


PRODUCT: "EXTERIOR DOOR PRODUCT"
DOUBLE 6'8" GLAZED
METAL-EDGE STEEL DOOR
PART OR ASSEMBLY:
TYPICAL ELEVATIONS
& GENERAL NOTES

NO.	DATE	ADDED SPACER	BY
A	12/15/08		SWS



DATE: 7/25/05
SCALE: N.T.S.
DWG. BY: SWS
CHK. BY:
DRAWING NO.:
DWG-MA-FL0134-05
SHEET 1 OF 3

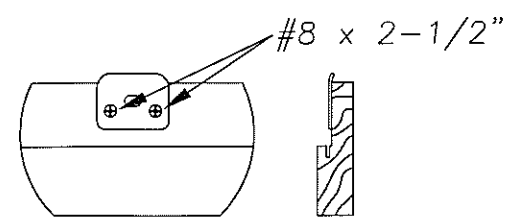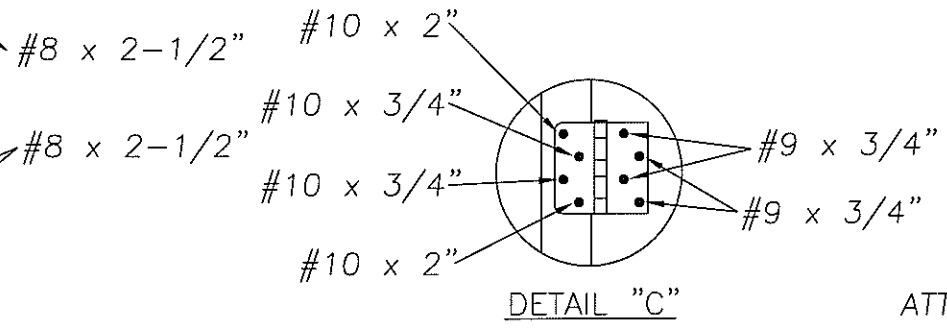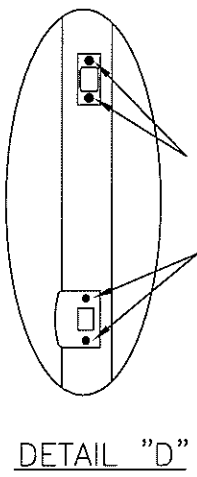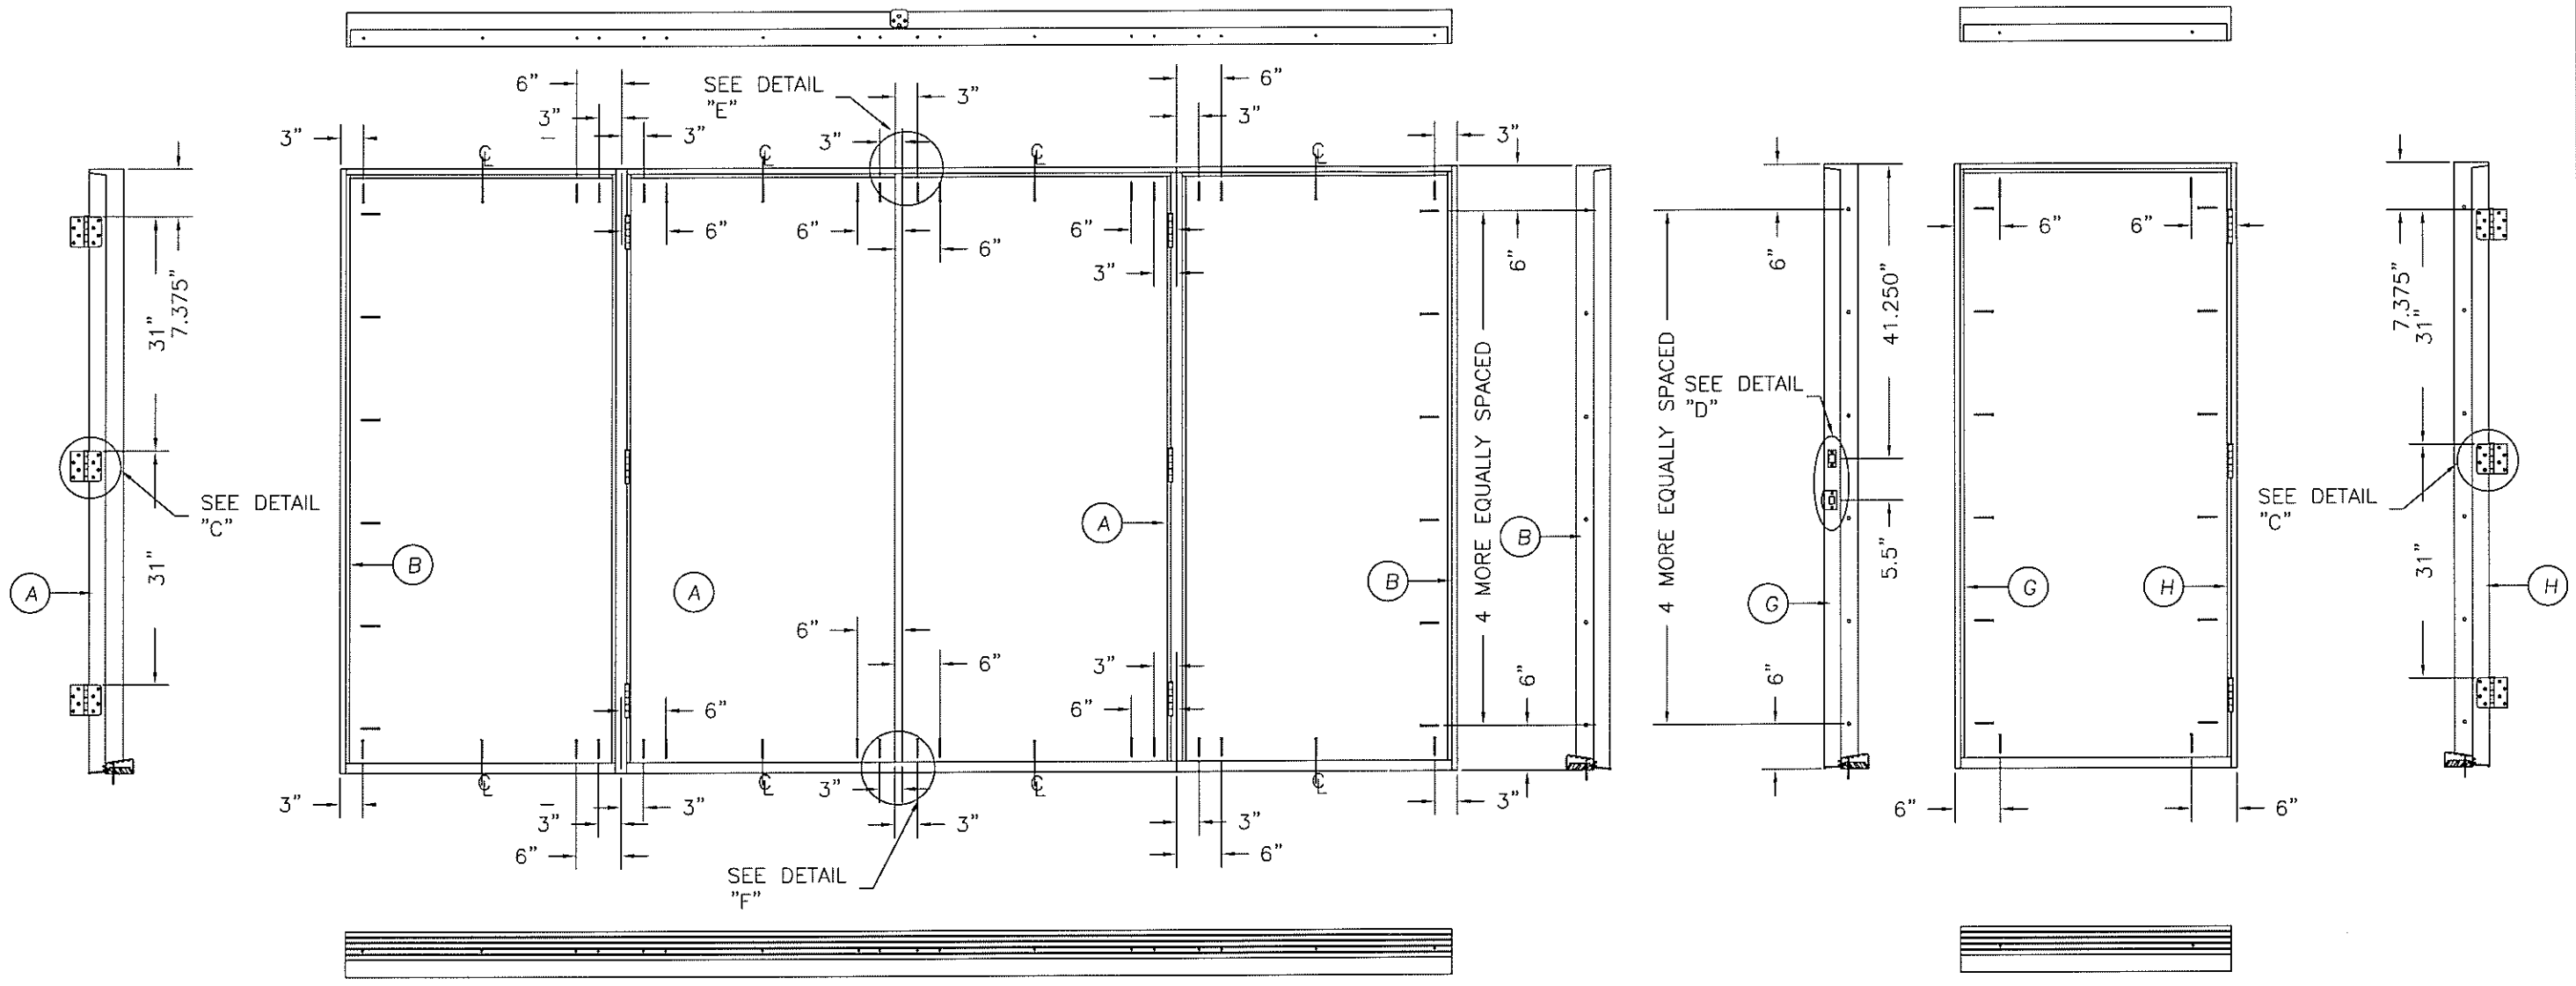

ATTACH ASTRAGAL RETAINER BOLT STRIKE PLATE TO FRAME AS SHOWN.

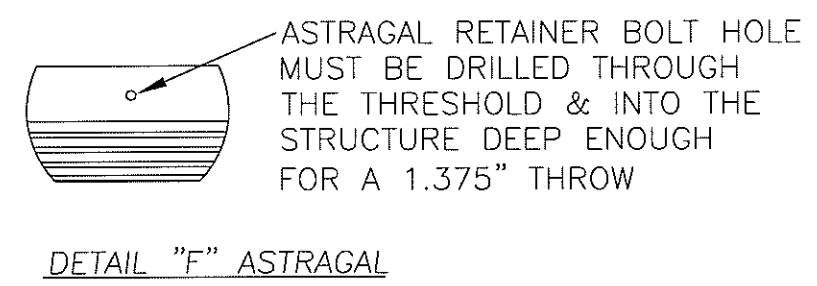


ASTRAGAL RETAINER BOLT HOLE MUST BE DRILLED THROUGH THE THRESHOLD & INTO THE STRUCTURE DEEP ENOUGH FOR A 1.375" THROW

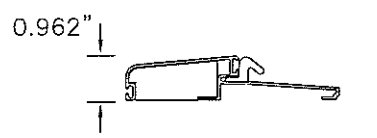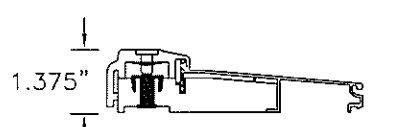

Addendum to NAM

Certification No.: NI006115-R2
 Reviewed By: [Signature]
 Date Reviewed: 12/18/08

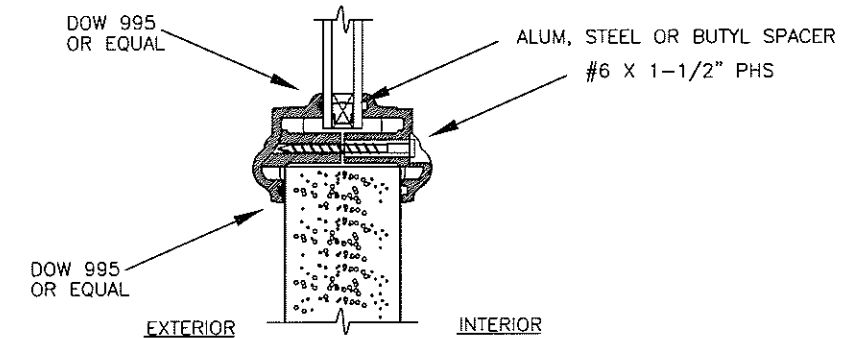

MASONITE INTERNATIONAL CORP.
 7300 REAMES RD.
 CHARLOTTE, NC 28216

PRODUCT: "EXTERIOR DOOR PRODUCT"
 DOUBLE 6'-8" GLAZED
 METAL-EDGE STEEL DOOR
 PART OR ASSEMBLY:
 ANCHORING LOCATIONS
 & DETAILS

NO.	DATE	ADDED SPACER	SWS BY	REVISIONS
A	12/15/08			

DATE: 7/25/05
 SCALE: N.T.S.
 DWG. BY: SWS
 CHK. BY:
 DRAWING NO.:
 DWG-MA-FL0134-05
 SHEET 2 OF 3

